



Medical Refrigeration Monitoring

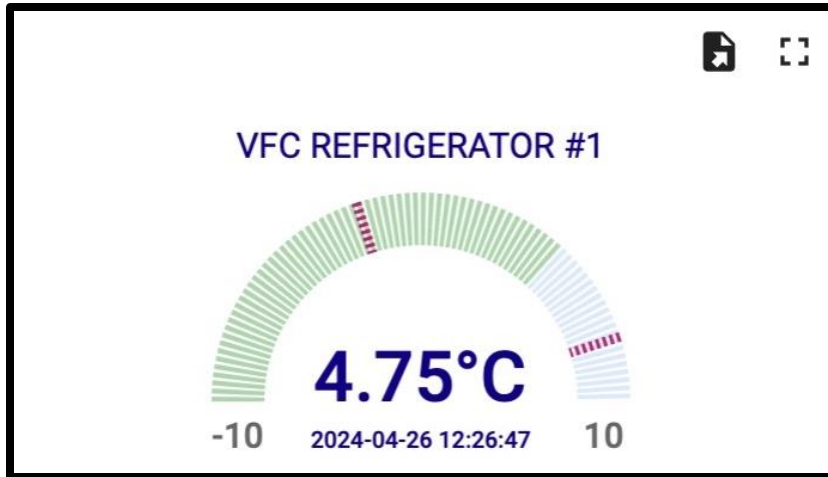

Room Temperatures	
Descriptor	Covid Room
Temperature	22.36 °C
Humidity	51.90 %
Descriptor	VFC Room
Temperature	23.77 °C
Humidity	44.10 %
Descriptor	Backup Room
Temperature	22.49 °C
Humidity	46.00 %

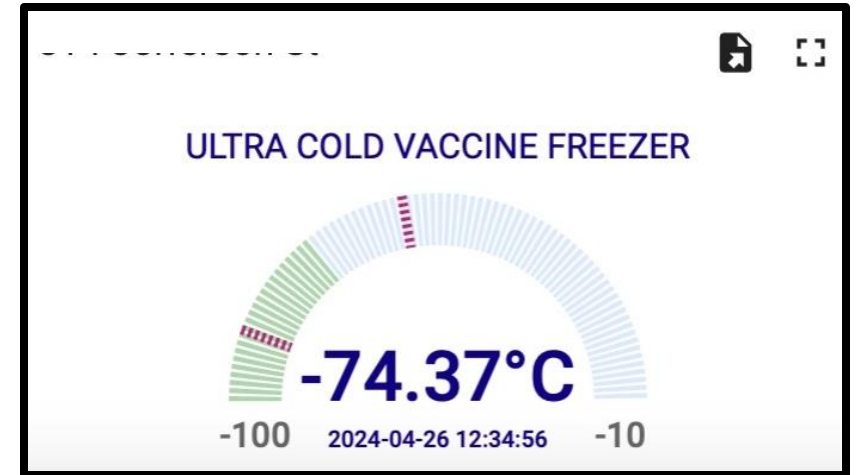

- Track medical supply temperatures and not just air temperatures
- Alerts when medical supply temperatures exceed defined thresholds
- Automated compliance meeting CDC digital monitoring guidelines
- Supports the Vaccine For Children's (VFC) program
- NIST certified, calibrated, and traceable sensors



NIST NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY
U.S. DEPARTMENT OF COMMERCE

